

FOUNDATION NOTES

1. Design Information and Loads

- A. Foundation design in accordance with 2022 Oregon Structural Specialty Code using the reactions provided by the metal building manufacturer for the following design criteria.
- B. Ground Snow Load 25 psf
- Roof Snow Load 25 psf
- C. Roof Collateral Load 5 psf
- D. Wind Speed 97 mph
- Exposure B
- E. Sps 0.640
- F. SDC D
- G. Frost Depth 1'-0"

2. Earthwork

- A. Foundation Design Values (assumed)
 - i. Allowable Soil Bearing Pressure - 1500 psf
 - ii. Coefficient of Friction - 0.25
 - iii. Passive Earth Pressure - 200 psf/ft of depth
- B. The building pad area shall be stripped of all frozen soil, debris, vegetation, and topsoil. All fill soils and any remaining loose natural soils shall be excavated to expose suitable natural soils.
- C. Proof roll the entire building pad area to locate and remove all soft spots. Replace with compacted structural fill.
- D. Place all footings and slabs on undisturbed natural soil or on properly compacted structural fill. Contractor shall verify that soil under footings is suitable to support footings.
- E. Structural Fill: Structural fill should consist of well-graded sandy gravels with a maximum particle size of 3 inches and 5 to 15 percent fines (materials passing the No. 200 sieve). The liquid limit of fines should not exceed 35 and the plasticity index should be below 15. All fill soils should be free from topsoils, highly organic material, frozen soil, and other deleterious materials. Structural fill should be placed in maximum 8-inch thick loose lifts at a moisture content within 2 percent of optimum and compacted to at least 95 percent of modified proctor density (ASTM D1557) under the building and 90 percent under concrete flatwork.

F. It is the responsibility of the contractor to ensure that the depth of the bottom of the foundation is far enough below the adjacent grade to ensure adequate frost protection.

3. Concrete and Reinforcement

- A. Material Standards
 - i. Concrete
 - a. Footings: Exposure Classes F0, S0, W0, CO
f'c = 3000 p.s.i., max. w/cm ratio = 0.55
 - b. Exterior Walls: Exposure Classes F1, S0, W0, CO
f'c = 3500 p.s.i., max. w/cm ratio = 0.55
 - c. Interior Walls: Exposure Classes F0, S0, W0, CO
f'c = 3000 p.s.i., max. w/cm ratio = N.A.
 - d. Interior Slabs: Exposure Classes F0, S0, W0, CO
f'c = 3500 p.s.i., max. w/cm ratio = 0.55
 - e. Air content for Exposures F1-F3 must meet the requirements of Table 19.3.3.1 of ACI 318-14. Air-entraining admixtures shall conform to ASTM C260.
 - f. Use Type II cement for Exposure Class S0. For Exposure Classes S1, S2 and S3 use Type II or Type V as required in Table 19.3.2.1 of ACI 318-14. Cement shall conform to ASTM C150
 - g. Calcium Chloride admixture shall not be used in Exposures S2 and S3
 - h. Normal weight aggregates - ASTM C33
 - ii. Reinforcing
 - a. Rebar - ASTM A615 Grade 60 (Fy = 60 ksi)
 - b. Welded wire - ASTM A1064
 - c. Epoxy/Adhesive - Simpson SET-XP (ICC-ES ESR-2508), Hilti RE-500V3 (ICC-ES ELC-3814), or Dewalt Pure110+ (ICC-ES ESR-3298) unless noted otherwise in the drawings.
 - iii. Anchor Rods/Bolts
 - a. All anchor rods shall be cast-in-place headed anchor rods. Use of post-installed (epoxy, adhesive, expansion, screw, etc.) anchors is not allowed without written permission from

- MVE or unless specifically noted in the drawings.
- b. Steel column anchor rods/bolts - ASTM F1554 Grade 36 with ASTM A563 heavy hex nuts and hardened washers (unless noted otherwise)
- c. Wood framing anchors - ASTM A307 with A36 plate washers
- d. Headed stud anchors (HSA) - ASTM A108
- e. Deformed bar anchors (DBA) - ASTM A496
- f. Screw Anchors for jamps as indicated in the typical anchor rod schedule - Simpson Titen HD (ICC-ES ESR-2713), Hilti Kwik HUS-TZ (ICC-ES ESR-3027), or Dewalt Screwbolt+ (ICC-ES ESR-2526)
- g. Use of hooked anchor rods/bolts is limited under the ACI and the OSSC. Headed anchor rods/bolts must be used where indicated in the details.
- h. The symbols \odot A.R./ \odot A.B. as shown in the drawings indicate the center line of the anchor rod/bolt pattern, not the center line of any individual anchor rod/bolt.
- B. Detail reinforcing to comply with ACI 315 "Manual of Standard Practice for Detailing Reinforcing Concrete Structures" and the Concrete Reinforcing Steel Institute (CRSI) recommendations.
- i. Minimum clear concrete cover for reinforcement shall be as follows unless noted otherwise:
 - a. Concrete cast directly against and permanently exposed to earth - 3"
 - b. Concrete exposed to weather or earth:
 - 1. #5 bars or smaller - 1 1/2"
 - 2. #6 bars or larger - 2"
 - c. Concrete not exposed to weather or in contact with the ground - 3/4"
 - d. Slabs on grade - as shown in details, 3/4" min. from top of slabs not exposed to weather
- ii. Lap Splice Lengths with 1 1/2" minimum clear cover
 - a. f'c = 2500-3500 p.s.i.

- 1. #6 and smaller - 49 bar diameters
- 2. #7 and larger - 76 bar diameters
- b. f'c = 4000 p.s.i. or greater
 - 1. #6 and smaller - 38 bar diameters
 - 2. #7 and larger - 60 bar diameters
- c. Increase lap splice lengths by 50% where epoxy coated bars are used.
- iii. Stagger splices in walls so that no two adjacent bars are spliced in the same location, unless shown otherwise.
- iv. Make all bars continuous around corners or provide corner bars of equal size and spacing.
- v. Where 12 inches or less of fresh concrete is placed below horizontal reinforcing lap splice length may be reduced by 30%.
- vi. Vertical bars in walls, grade beams, and piers to terminate in footings with ACI standard hooks (12 bar diameters) to within 4" of the bottom of the footing unless noted otherwise.
- vii. Horizontal wall reinforcing shall terminate at the ends of walls with a 90 degree hook plus a 6 bar diameter extension, unless shown otherwise.
- viii. Horizontal wall reinforcing shall be continuous through construction and control joints.
- ix. Splices in horizontal reinforcement shall be staggered. Splices in two curtains (where used) shall not occur in the same location.
- x. Use chairs or other support devices as required for proper clearance.
- xi. Rebar hairpins shall be centered in slabs and shall be wire tied to the slab reinforcing (if any). Rebar hairpins shall be continuous through walls and piers; lap splices in hairpins may only occur in the floor slab unless noted otherwise.
- C. Control joints in slabs on grade are recommended to control cracking. See plans for control joint spacing and details.
- D. Slabs and grade beams shall not have joints in a horizontal plane. All reinforcement shall be continuous through all construction joints.
- E. Floor slab thickness and reinforcing shown in these drawings are adequate to support typical uniform loads only. Mountain View

Engineering has not designed the slab for any specific concentrated forces such as those from vehicles, storage racks, or heavy equipment (unless noted otherwise).


F. Welding of rebar is not allowed unless specifically indicated in the drawings. All embedments, reinforcing, and dowels shall be securely tied to framework or to adjacent reinforcing prior to placement of the concrete. Tack welding of rebar joints in grade beams, walls, or cages is not allowed. Where welding of rebar is shown in the drawings, all rebar to be welded shall be ASTM A706 Grade 60.

4. Special Inspections

- A. Concrete
 - i. Spot Footings - Not required (OSSC 1705.3 Exception 1)
 - ii. Continuous Ftgs. - Not required (OSSC 1705.3 Exception 2.3)
 - iii. Slabs - Not required (OSSC 1705.3 Exception 3)
 - iv. Grade Beams - Not required (OSSC 1705.3 Exception 4)
 - v. Walls - Not required (OSSC 1705.3 Exception 4)
 - vi. Anchor rods/bolts - Required (OSSC Table 1705.3) Special inspection may be waived subject to the approval of the building official.
- B. Steel Reinforcement
 - i. Placement - Third party special inspection of reinforcing placement need only be performed where specifically required by the building official.
 - ii. Welding - Special inspection of rebar welding is required (if any is used).

5. Miscellaneous

- A. The contractor shall notify engineer of any variations in dimensions.
- B. The engineer is not responsible for any deviations from these plans unless such changes are authorized in writing by the engineer.

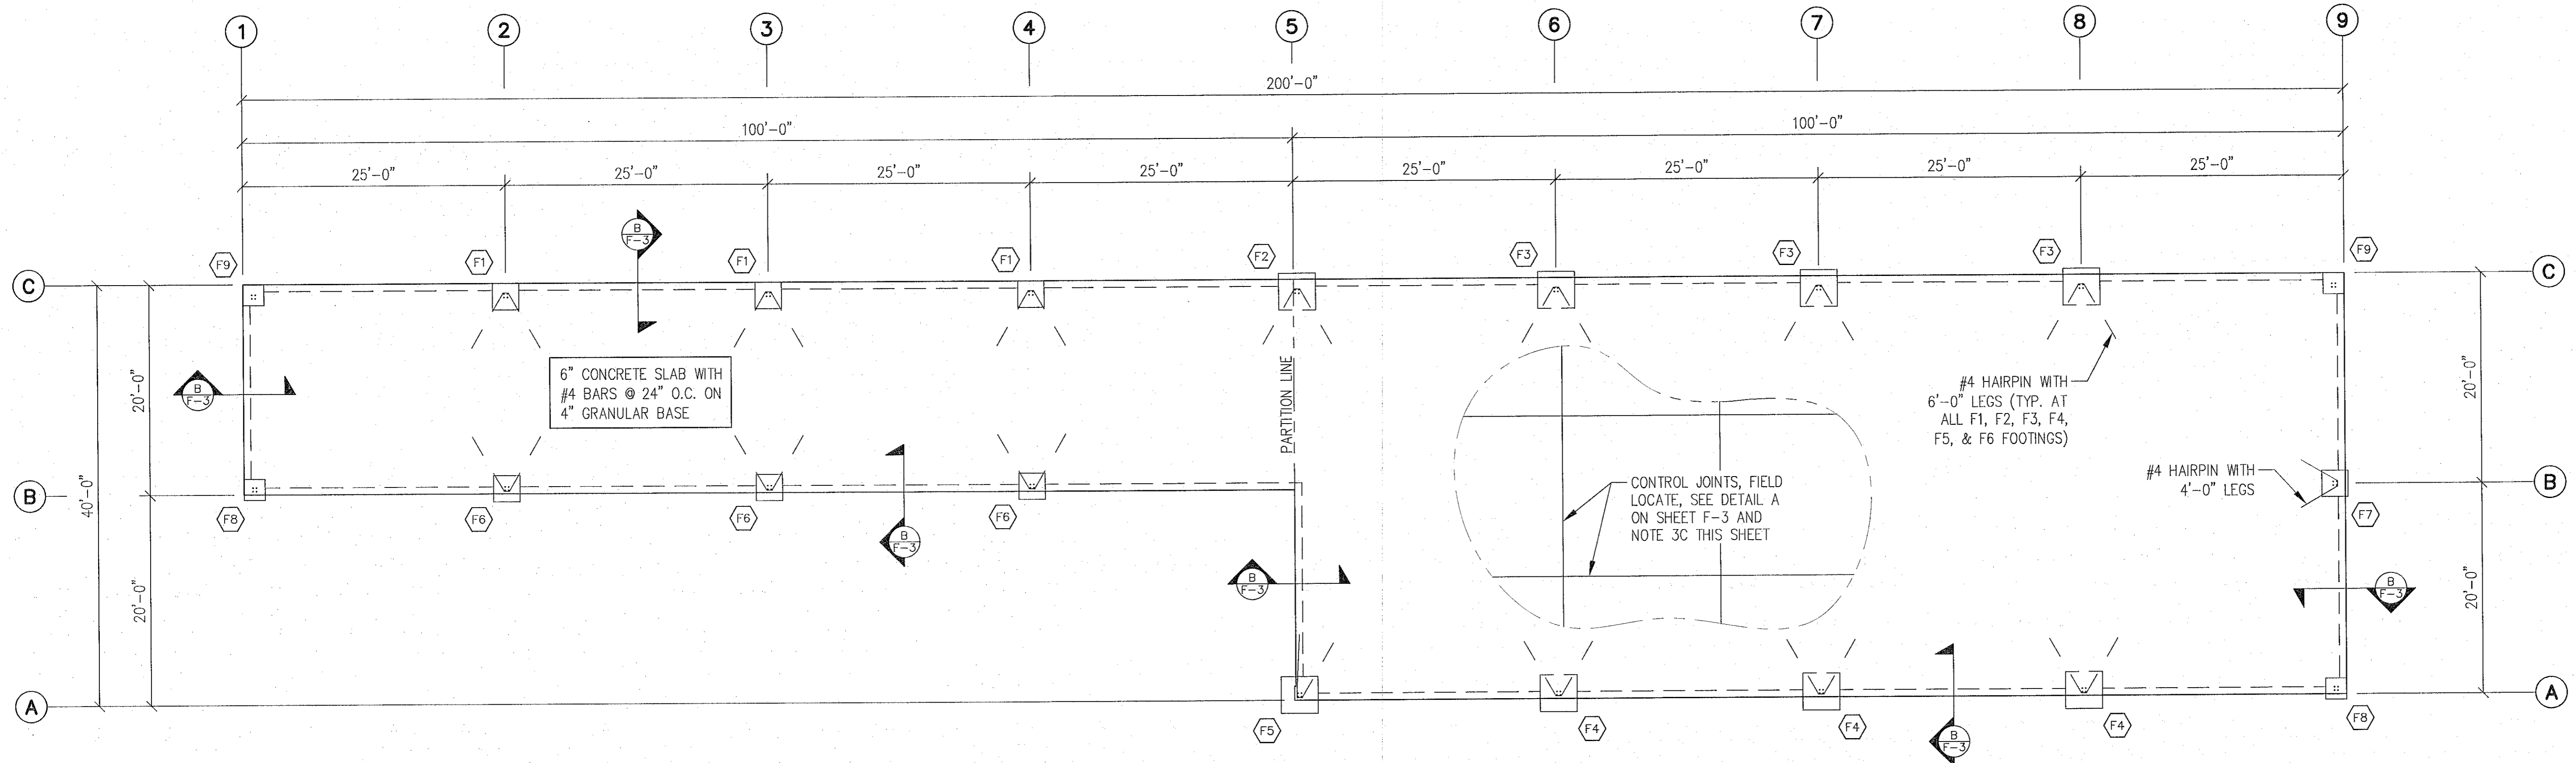

DIA.	EMBED	LENGTH	PROJECTION PER ANCHOR PLAN
1/2"	10"		
5/8"	12"		
3/4"	14"		
7/8"	18"		
1"	22"		
1 1/8"	24"		
1 1/4"	24"		

*AT OPENING JAMBS, 1/2"x4" OR 5/8"x4" SCREW ANCHORS MAY BE USED IN LIEU OF CAST-IN-PLACE ANCHORS. OPENING JAMB ANCHORS ARE NOT SHOWN ON THIS DRAWING, SEE METAL BUILDING ANCHOR PLAN.

\odot F1 INDICATES APPLICABLE FOOTING DETAIL.

FOUNDATION PLAN
SCALE: 1/8"=1'-0"

NOTE: COORDINATE THIS DRAWING WITH THE PACIFIC BUILDING SYSTEMS ANCHOR BOLT PLAN.

RECEIVED
By Doc Control at 3:55 pm, Sep 13, 2023

MOUNTAIN VIEW ENGINEERING, INC.
 Design
 Consulting
 Structural Engineering
 345 North Main Street Ste. A, Brigham City, Utah 84302 (435) 734-9700 Fax: (435) 734-9519


FOUNDATION PLAN
DOUGLAS COUNTY PUBLIC WORKS
STORAGE BUILDING
ROSEBURG, OREGON
 SHEET TITLE:
 JOB NAME:
 LOCATION:
 CONTRACTOR:

DATE	BY	DESCRIPTION
9-13-23	T.W.	FOR PERMIT


SEP 13 2023
 STRUCTURAL
 REGISTERED PROFESSIONAL
 ENGINEER
 95267PE
 OREGON
 BRAD WALLACE
 EXPIRES: 06-30-2024

SHEET NUMBER:
F-1


DRAWN BY: T.W.
 ENGINEER: A. STROMNESS
 MVE JOB NUMBER: **23-0938**

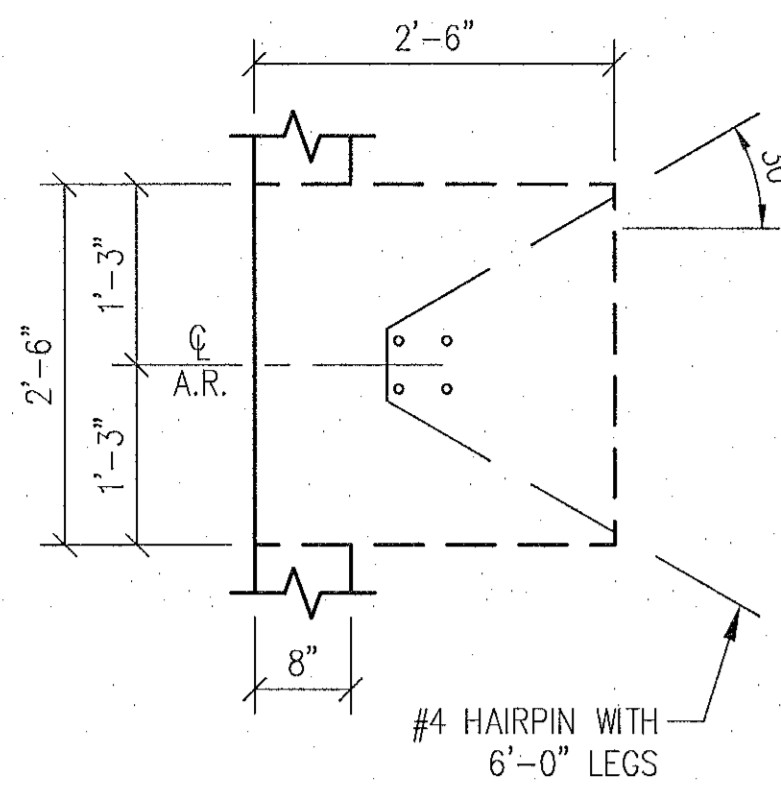


F1 3/4"=1'-0" SIDEWALL FOOTING DETAIL

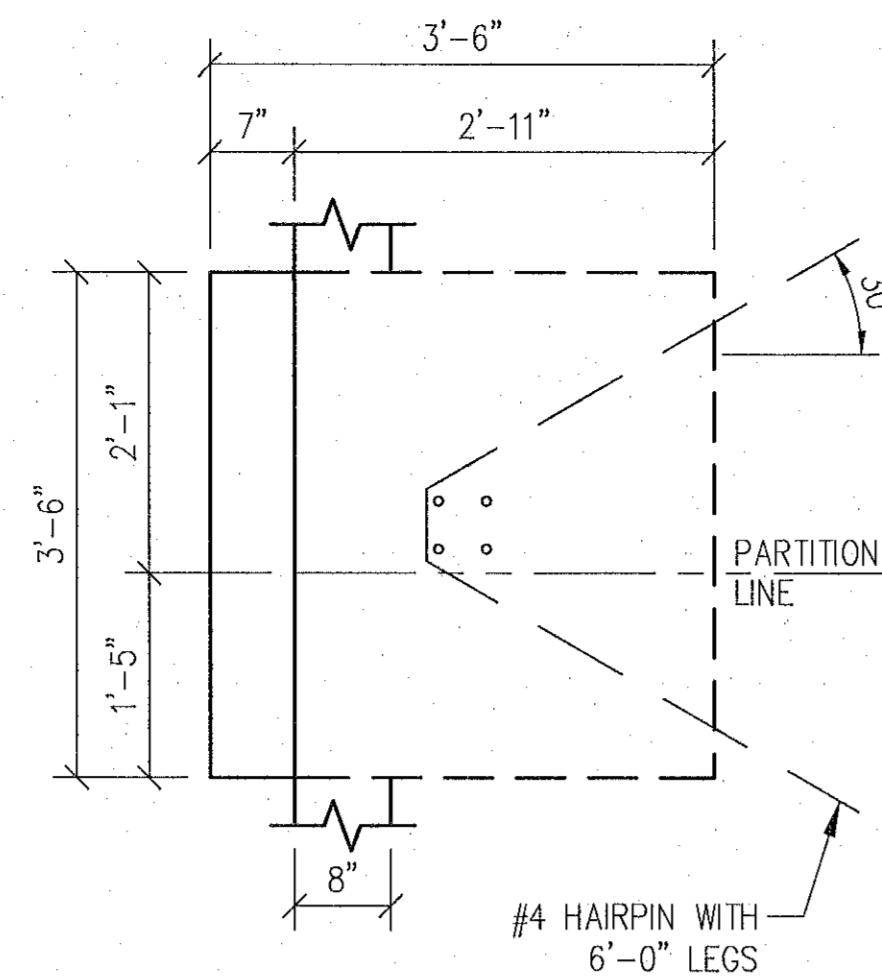


F2 3/4"=1'-0" SIDEWALL FOOTING DETAIL

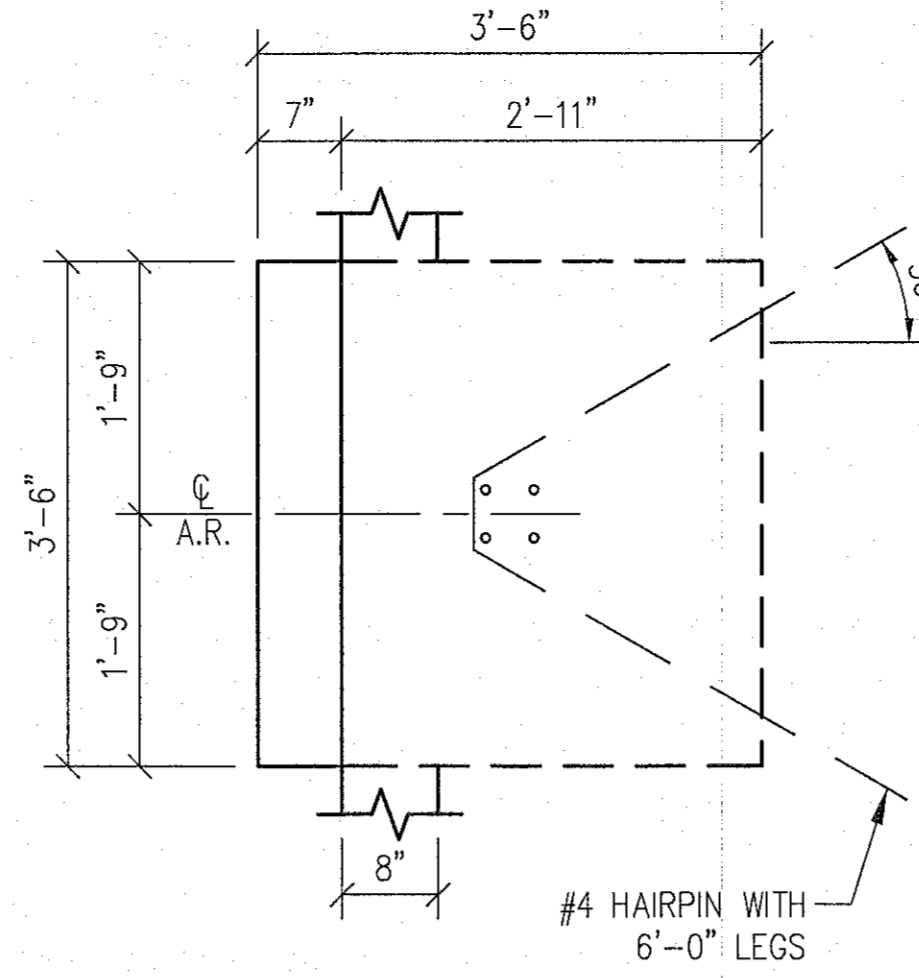







F3 3/4"=1'-0" SIDEWALL FOOTING DETAIL

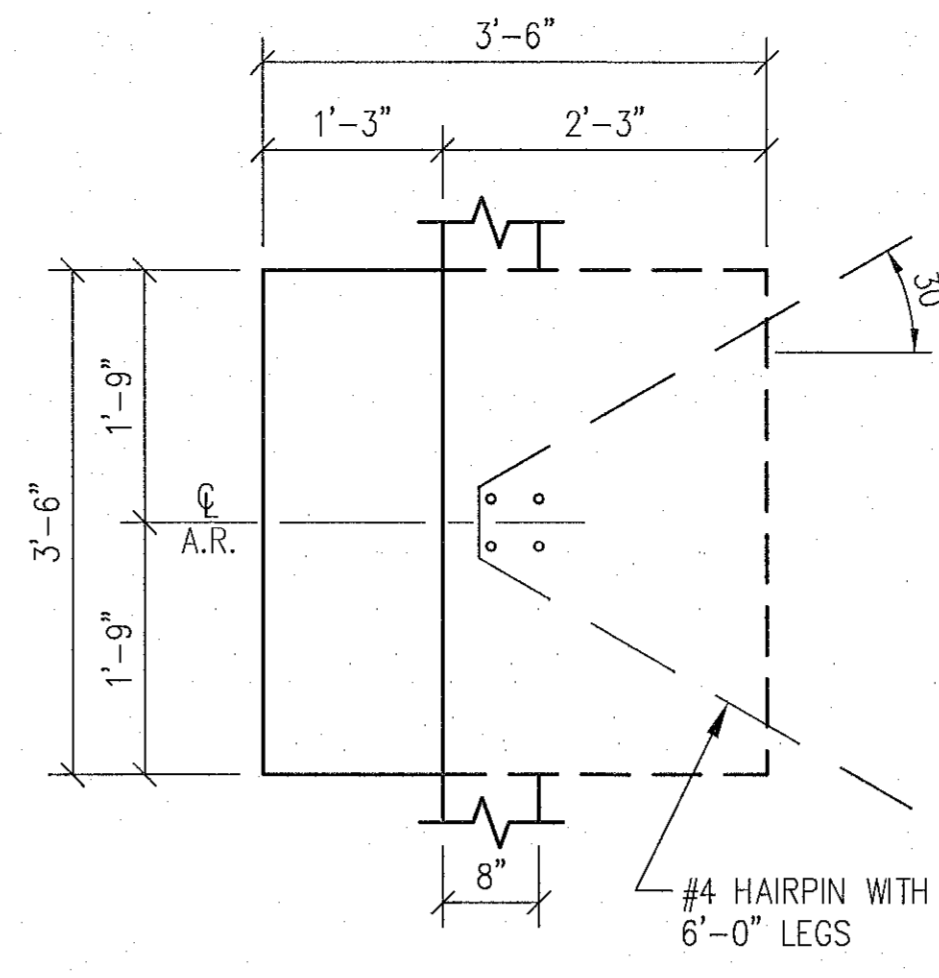


F4 3/4"=1'-0" SIDEWALL FOOTING DETAIL

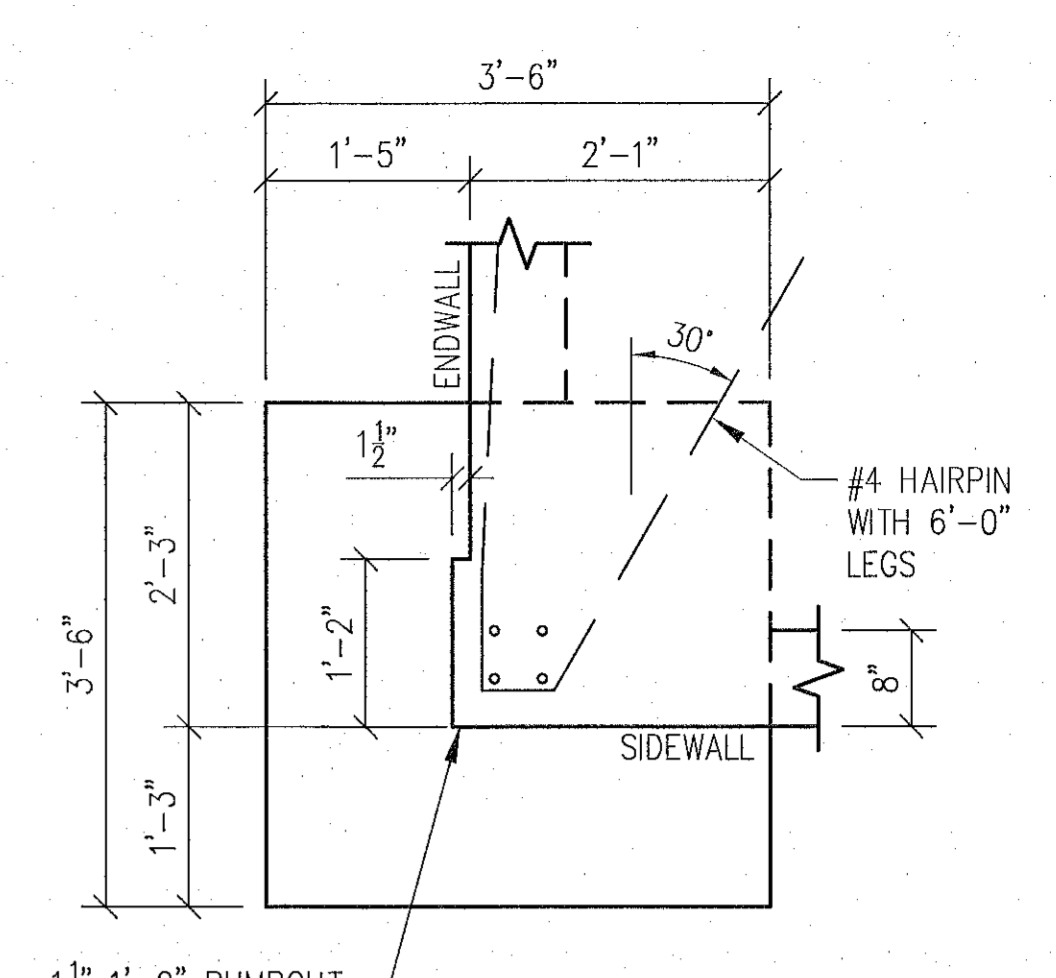


F5 3/4"=1'-0" CORNER FOOTING DETAIL

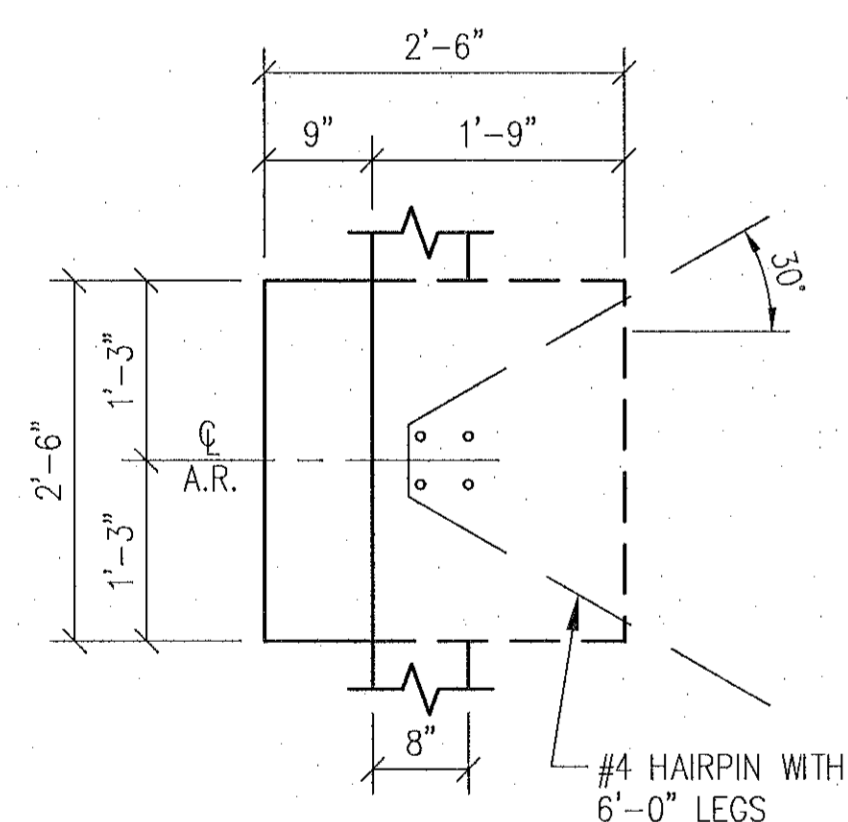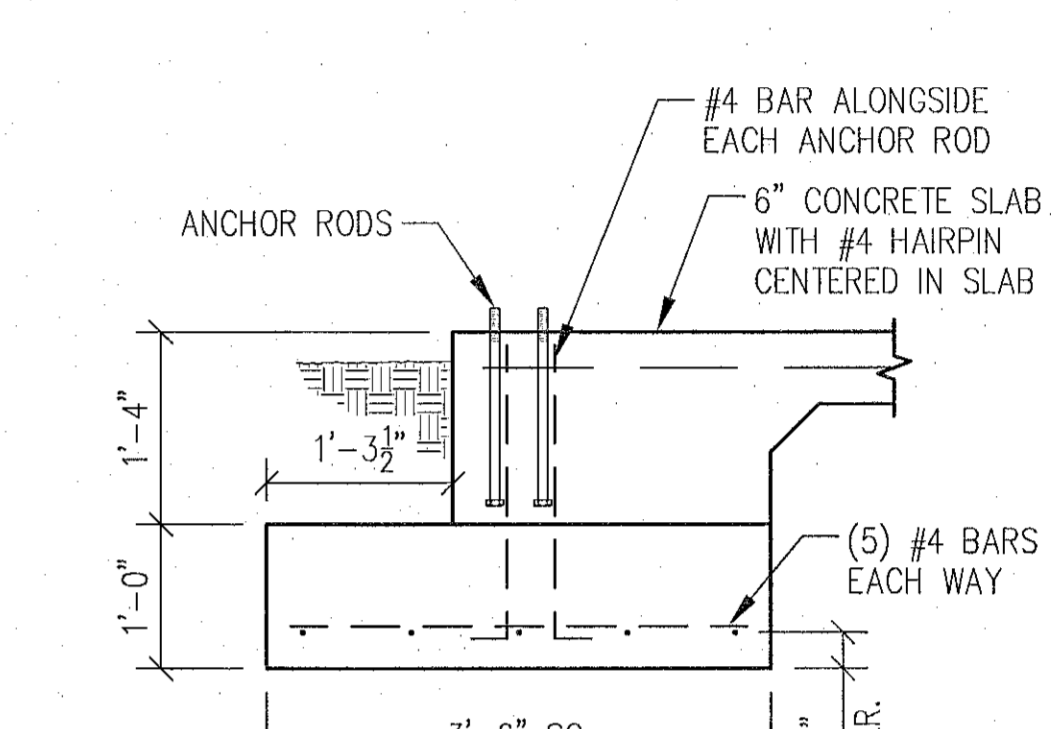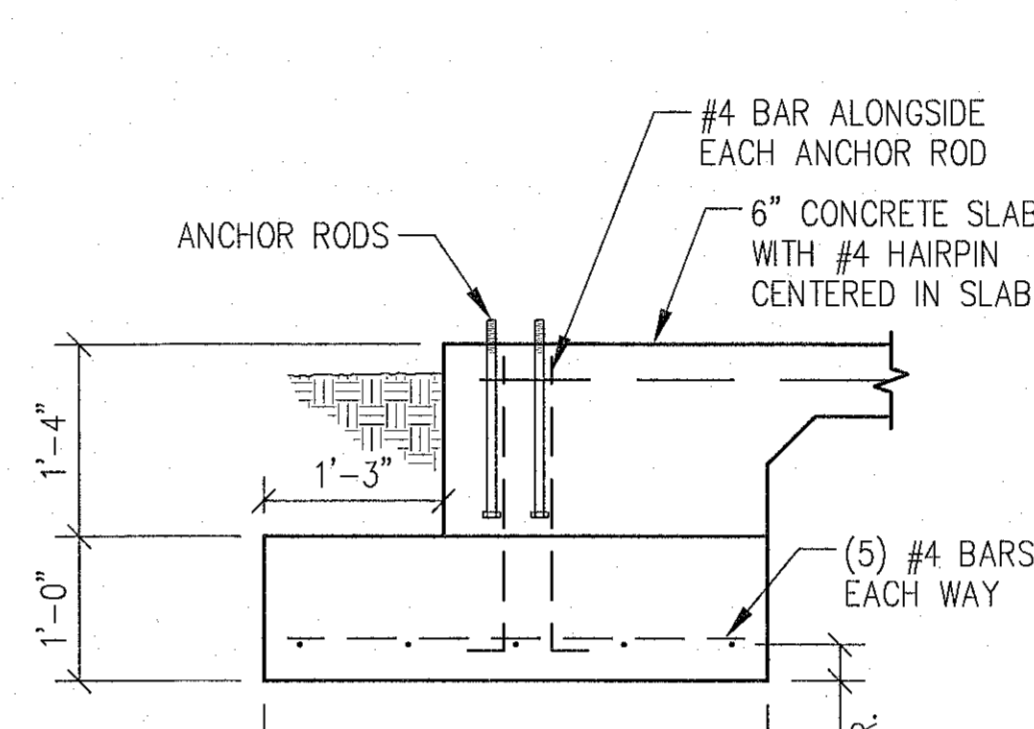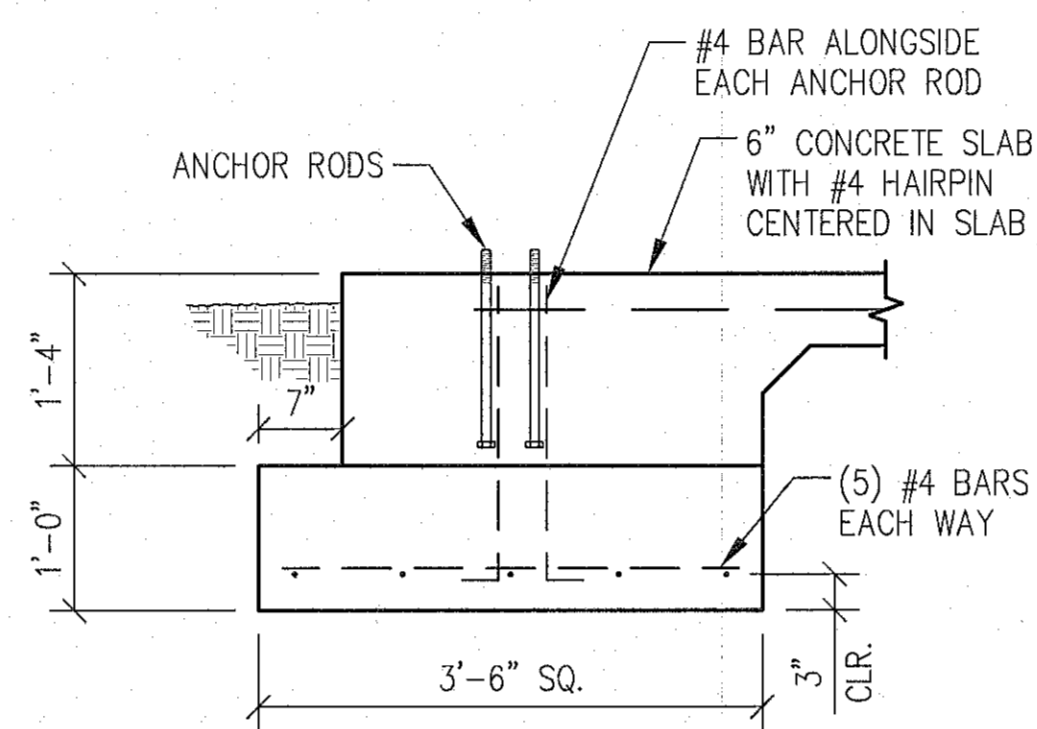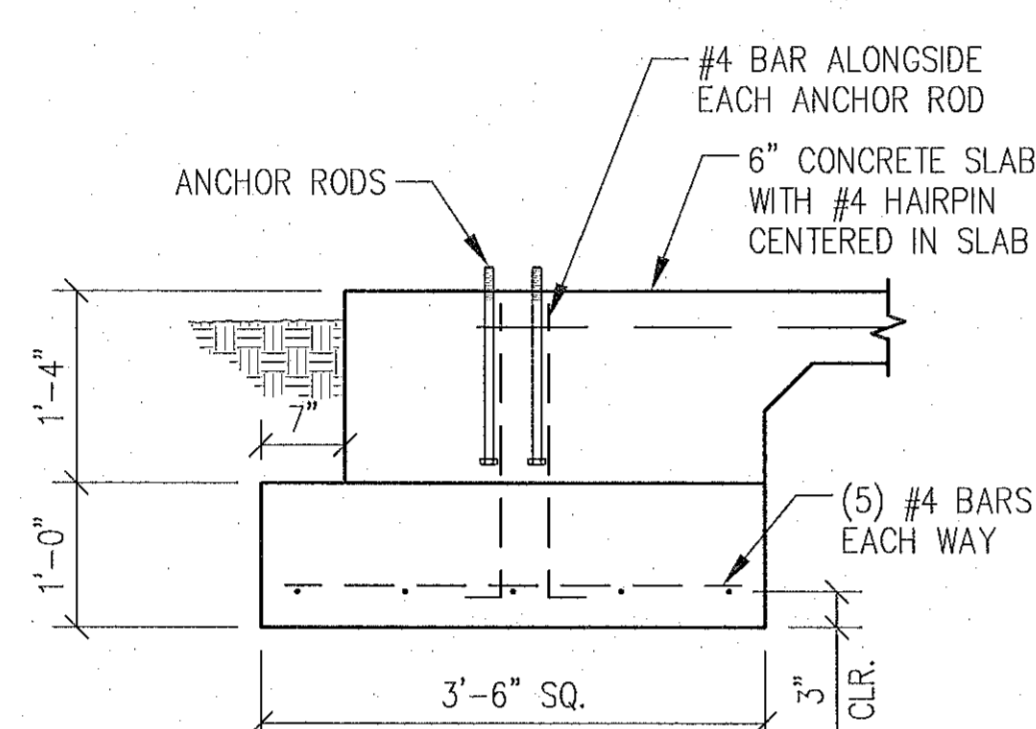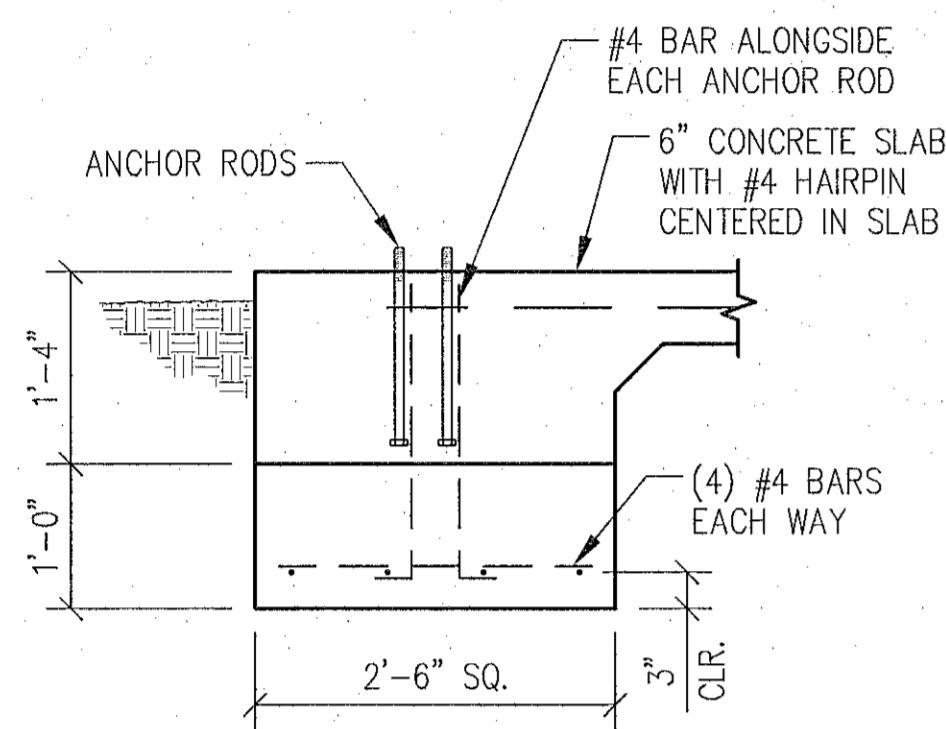


F6 3/4"=1'-0" SIDEWALL FOOTING DETAIL

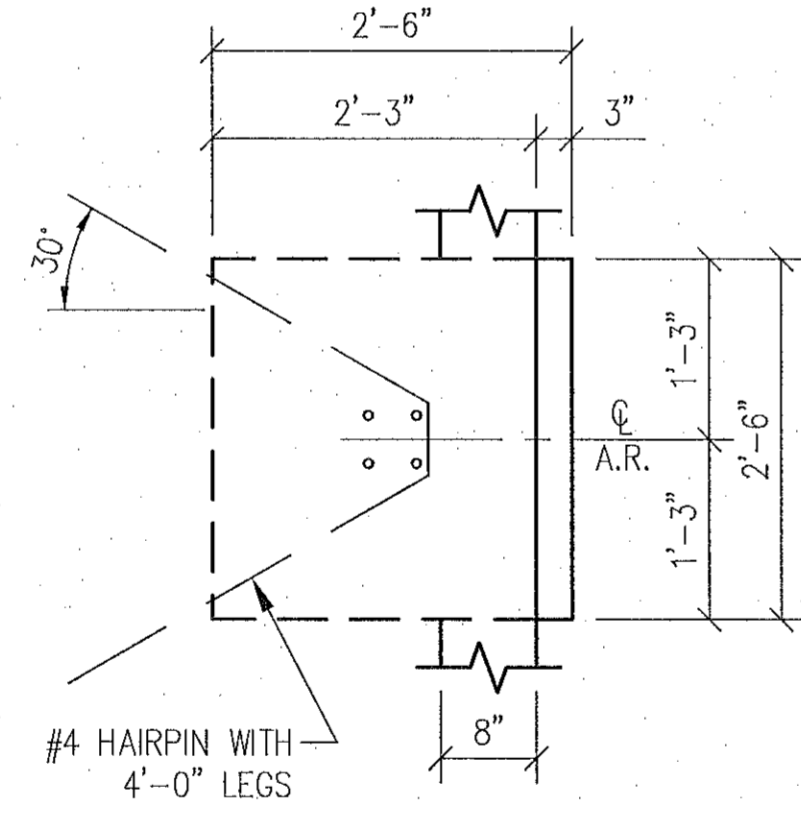





F7 3/4"=1'-0" ENDWALL FOOTING DETAIL

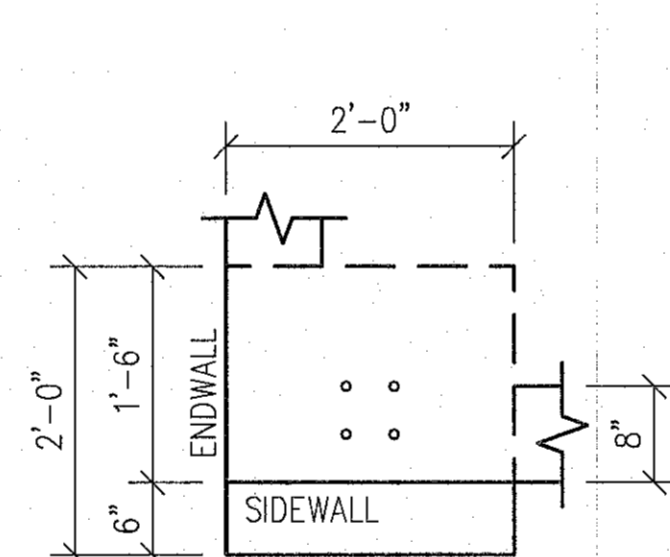

F8 3/4"=1'-0" CORNER FOOTING DETAIL

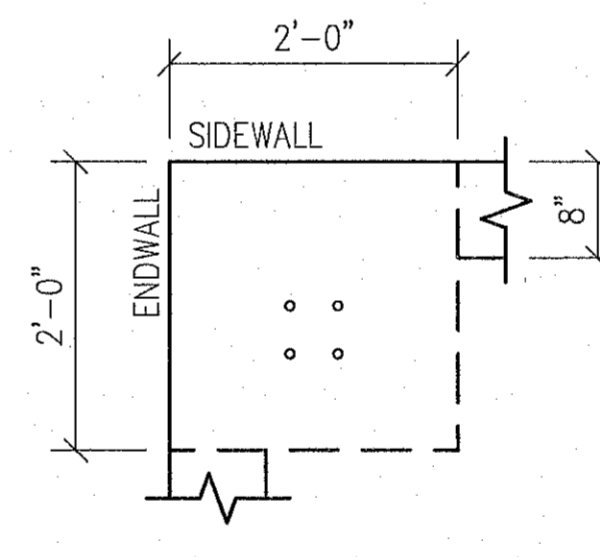

F9 3/4"=1'-0" CORNER FOOTING DETAIL

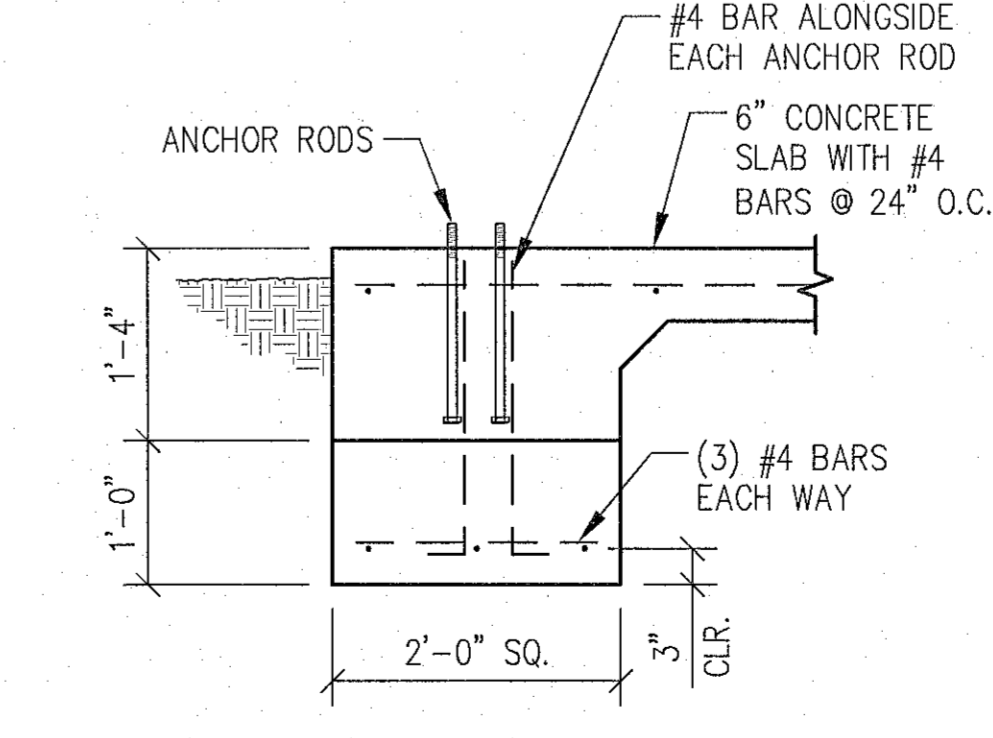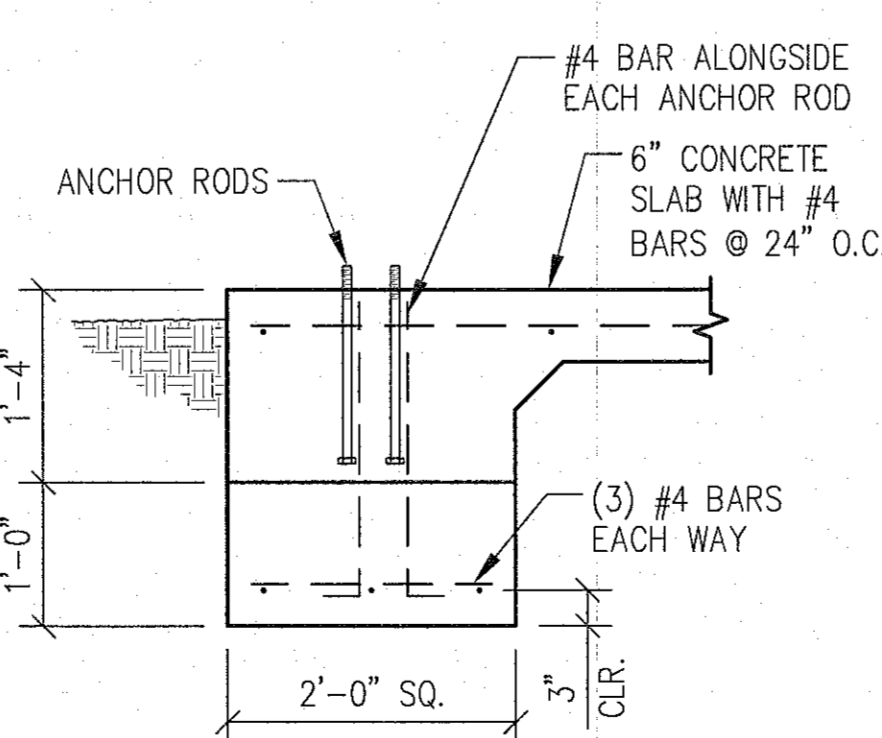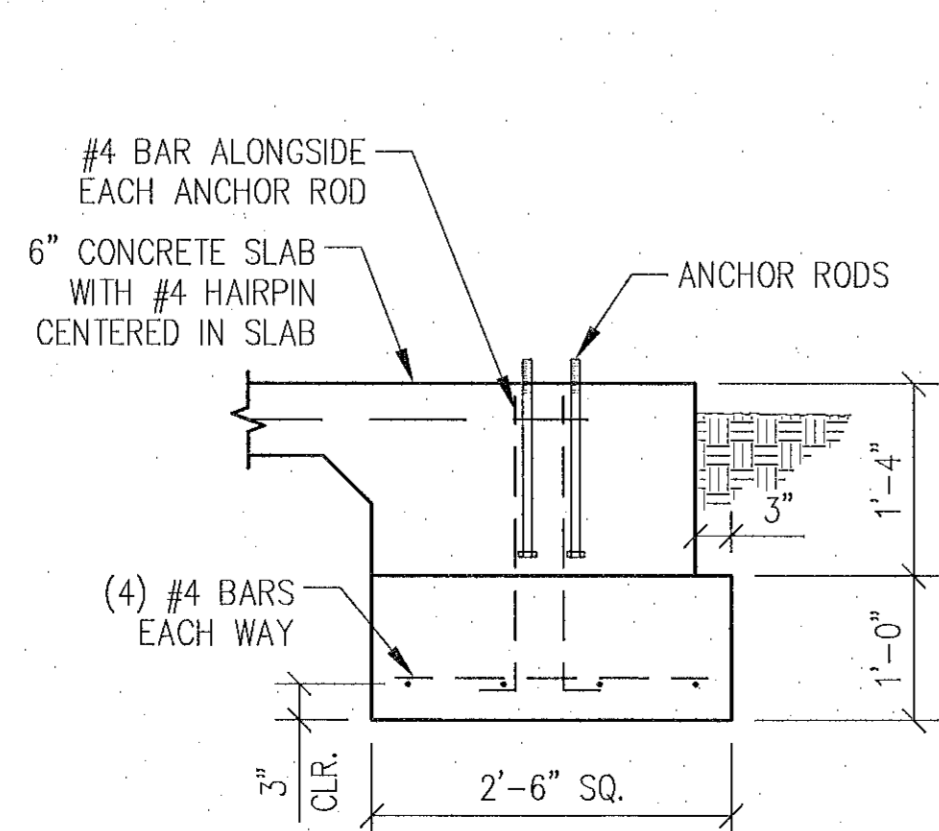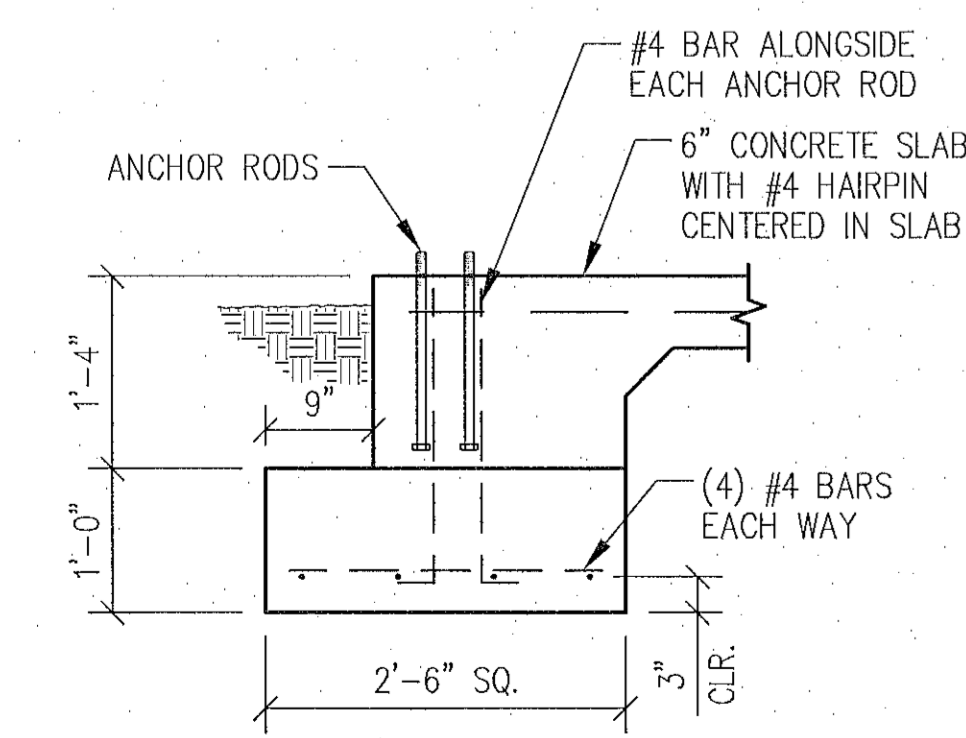

MOUNTAIN VIEW ENGINEERING, INC.
 Consulting
 Structural Engineering
 345 North Main Street, Ste. A, Brigham City, Utah 84302 (435) 734-9700 Fax (435) 734-9819
 Design


FOUNDATION DETAILS
DOUGLAS COUNTY PUBLIC WORKS
STORAGE BUILDING
 ROSEBURG, OREGON
 SHEET TITLE:
 JOB NAME:
 LOCATION:
 CONTRACTOR:

PLAN ISSUE DATES	
DATE	DESCRIPTION
9-13-23	FOR PERMIT


SEP 13 2023
 REGISTERED PROFESSIONAL
 ENGINEER
 95267PE
 BRAD WALLACE
 EXPIRES: 06-30-2024

SHEET NUMBER:
F-2

DRAWN BY: T.W.
 ENGINEER: A. STROMNESS
 MVE JOB NUMBER: 23-0938

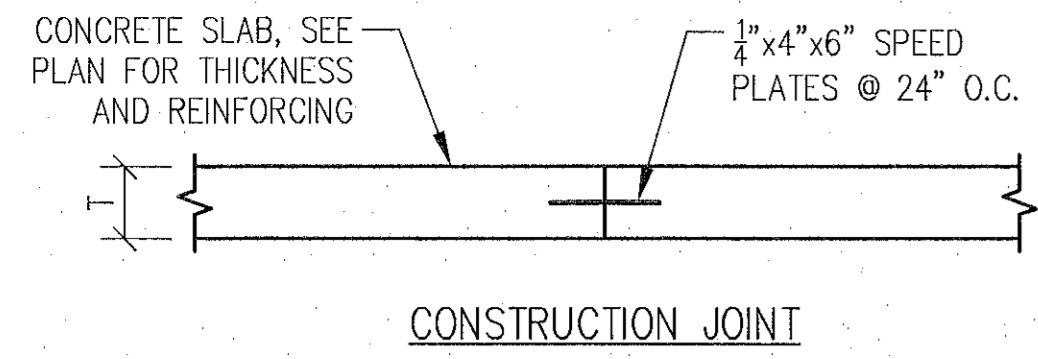

CONSTRUCTION JOINT

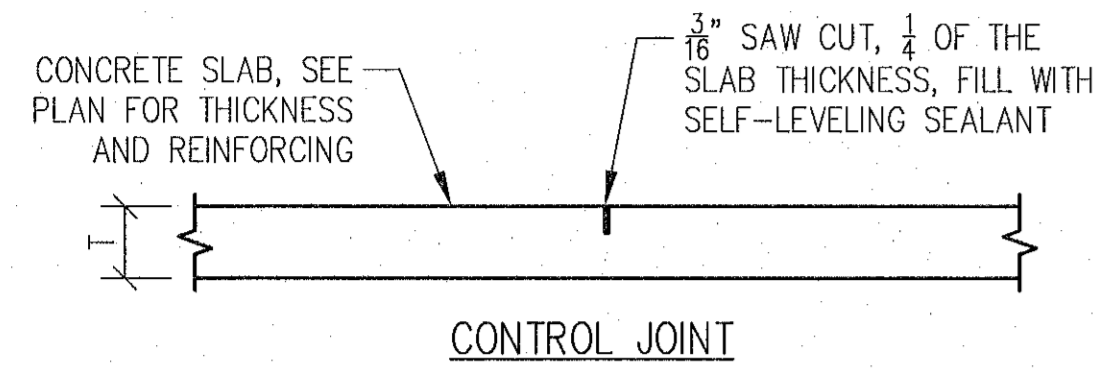

CONTROL JOINT


A CONTROL JOINTS
N.T.S.

CONTROL JOINT NOTES:


- Control joints shall be field located by the contractor.
- Control joints shall be located to limit the frequency and width of random cracks in the concrete slab.
- Locate and install control joints in accordance with ACI 360R "Design of Slabs on Ground" and the details shown.
- Maximum spacing of joints shall be per the table below.
- Saw cuts should be made as soon as possible.

MAXIMUM SPACING OF CONTROL JOINTS

Slab thickness (T), in.	Slump 4 in. to 6 in.	
	Maximum-size aggregate less than 3/4 in.	Maximum-size aggregate 3/4 in. and larger
4	8 ft.	10 ft.
5	10 ft.	13 ft.
6	12 ft.	15 ft.
7	14 ft.	18 ft.
8	16 ft.	20 ft.

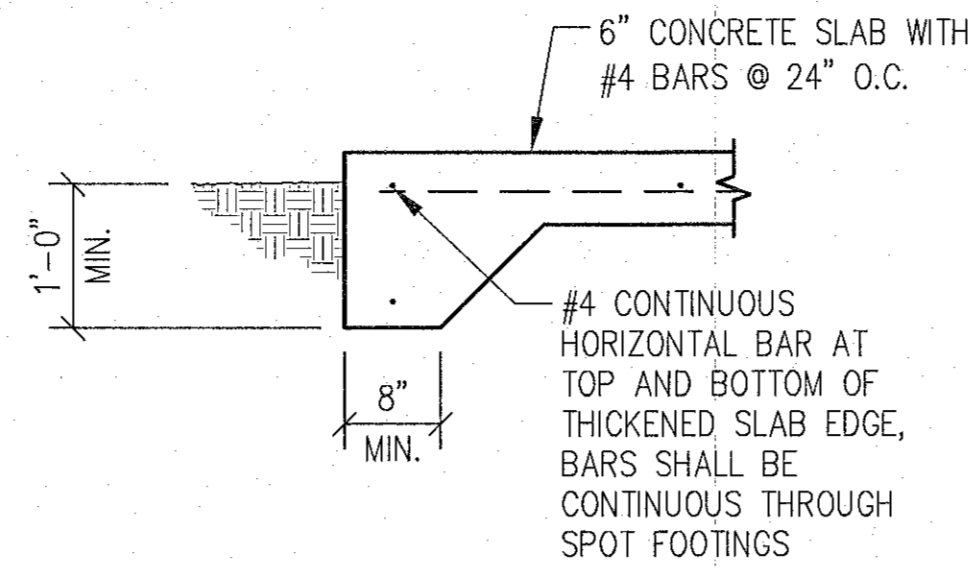

B THICKENED SLAB EDGE DETAIL
3/4"=1'-0"



MOUNTAIN VIEW ENGINEERING, INC.

Structural Engineering Consulting Design
345 North Main Street, Ste. A, Brigham City, Utah 84302 (435) 734-9700 Fax (435) 734-9519

SHEET TITLE: FOUNDATION DETAILS

JOB NAME: DOUGLAS COUNTY PUBLIC WORKS STORAGE BUILDING

LOCATION: ROSEBURG, OREGON

CONTRACTOR: -

PLAN ISSUE DATES

DATE	BY	DESCRIPTION
9-13-23	T.W.	FOR PERMIT



SHEET NUMBER:
F-3

DRAWN BY: I.W.
ENGINEER: A. STROMNESS
MVE JOB NUMBER: **23-0938**